

National Manual of Assets and Facilities Management

Volume 5, Chapter 4

HVAC Systems Operations – Parks and Recreation Procedure



Document No. EOM-ZO0-PR-000015 Rev 001



Document Submittal History:

Revision:	Date:	Reason For Issue
000	28/03/2020	For Use
001	18/08/2021	For Use



THIS NOTICE MUST ACCOMPANY EVERY COPY OF THIS DOCUMENT

IMPORTANT NOTICE

This document, ("Document") is the exclusive property of Government Expenditure & Projects Efficiency Authority.

This Document should be read in its entirety including the terms of this Important Notice. The government entities may disclose this Document or extracts of this Document to their respective consultants and/or contractors, provided that such disclosure includes this Important Notice.

Any use or reliance on this Document, or extracts thereof, by any party, including government entities and their respective consultants and/or contractors, is at that third party's sole risk and responsibility. Government Expenditure and Projects Efficiency Authority, to the maximum extent permitted by law, disclaim all liability (including for losses or damages of whatsoever nature claimed on whatsoever basis including negligence or otherwise) to any third party howsoever arising with respect to or in connection with the use of this Document including any liability caused by negligent acts or omissions.

This Document and its contents are valid only for the conditions reported in it and as of the date of this Document.



Table of Contents

1.0	PURPOSE	6
2.0	SCOPE	6
3.0	DEFINITIONS	7
4.0	REFERENCES	8
5.0	RESPONSIBILITIES	9
5.1	Organizational Structure	9
5.2	Management Responsibilities	10
5.3	Designated Person	10
5.4	Authorized Engineer (Ventilation) (AE (V))	10
5.5	Authorized Person (Ventilation) (AP (V))	10
5.6	Competent Person (Ventilation) (CP (V))	10
5.7	Plant Operator	11
5.8	End User	11
5.9	Contractor	11
6.0	PROCESS	11
6.1	Operations Management	11
6.1.1	Operational Policy	11
6.1.2	Monitoring of the Operational Policy	11
6.2	Risk Management	11
6.3	Emergency Management	11
6.4	Operational Considerations	12
6.4.1	Health, Safety, Security, and Environment (HSSE)	12
6.4.2	Environmental	12
6.4.3	Records/drawings	12
6.4.4	Training	12
6.5	HVAC Fundamentals	12
6.6	Systems Overview	13
6.6.1	HVAC Plant & Equipment	13
6.7	Building Management Systems (BMS)	13
6.8	Example of the Sub system found within HVAC	14
6.9	Sample of Equipment found within System	14
7.0	START-UP PROCEDURE	14
8.0	SHUTDOWN PROCEDURE	14
9.0	SYSTEMS MONITORING/DAILY ROUNDS	15
9.1	Monitoring	15
10.0	EMERGENCY RESPONSE ACTIONS	15
10.1	Airborne Contamination	15
10.1.1	Causes	15
10.1.2	Effects	15
10.1.3	Response Actions	16
10.1.4	Investigation	16
10.1.5	Damage Control	16
10.1.6	Debriefing	16
10.1.7	Review Procedure	16
10.1.8	Training and Information	16
10.1.9	Examples of Templates Procedures and Checklists	16
11.0	ATTACHMENTS	17
	Attachment 1 – EOM-ZO0-TP-000048 – Start-Up Checklist - HVAC Systems - Parks & Recreation	18
	Attachment 2 – EOM-ZO0-TP-000049 – Start-Up Checklist - HVAC Systems - Parks & Recreation	19
	Attachment 3 – EOM-ZO0-TP-000050 – Systems Monitoring/Daily Rounds Checklist - HVAC Systems - Parks & Recreation	20



HVAC Systems Operations – Parks and Recreation Procedure

Attachment 4 – EOM-ZO0-TP-000051 – Emergency Response Action Checklist - HVAC Systems - Parks & Recreation.....	21
---	----



1.0 PURPOSE

Heating, Ventilation & Air Conditioning (HVAC) is used extensively in all types of parks & recreational premises to provide a safe and comfortable environment for occupants. The aim of air conditioning is to control the thermal environment, largely through simple adjustments to air temperatures. The method by which air temperature is adjusted, and the effect that this has on overall comfort control, will depend on the form of air conditioning employed and its ability to provide a uniform thermal environment.

The introduction to HVAC systems provides a generic overview of the types of systems that are likely to be found within a park or recreational facility, but is not as comprehensive, as the requirements of each facility will differ according to its particular function.

The Operations Management for HVAC systems document has been compiled utilizing the latest references available for inclusion within the manual but may be subject to change throughout the lifetime of the National Manual of Assets and Facilities Management.

The purpose of this document is to provide the Entity in the Kingdom of Saudi Arabia (KSA) the procedural guidelines for Operations Management of HVAC systems in parks & recreational facilities. Its application is mandated by Royal Decree passed by the Saudi Council of Ministers which dictate that HVAC systems for parks & recreational facilities be operated in a safe, efficient, and compliant manner. These guidelines contain operational expectations consistent with the Expro approach, using best practice developed through industry experience.

The intention of this document is to provide adequate reference and methodology to Entities, facilities managers, and service providers to assist with the creation of their own documents and processes and to serve as an aid for engaging with external parties for service delivery.

References have been provided within the document to direct users to the 'specific' requirements of any decree or regulation as a point of reference. Where only a summary is provided within the guidelines, the actual reference should always be the standard that shall be employed.

2.0 SCOPE

The Operations Management Guidelines establish the uniform practical criteria and standards for HVAC systems and equipment, to enable quality, and cost-effective facilities maintenance that meet the needs and expectations of the Entity.

The Entity will need specific operational procedures for parks & recreational facilities the conditions of which may dictate the need to exceed the minimum requirements outlined within these guidelines.

The provision of these guidelines is not intended to prohibit the use of alternative systems, and methods, not specifically described. However, the use of alternative systems, and methods, can only be considered after receiving approval from the Entity.

This chapter should contribute to a facility's operational policy that may cover various aspects of HVAC systems. Staff responsible for the safe use of a HVAC system should receive specific training before being permitted to handle a system or associated equipment. This document shall outline the key personnel involved in the operation, and general use of the system.

For the purpose of this document "parks and recreational facilities" have been defined as all buildings and structures, or parts thereof, which are under the ownership or control of a municipal Entity controlling parks and recreation in which the resources and services are provided for the purposes of leisure, entertainment, and recreational pursuits. Resources may be public spaces and facilities like parks, nature preserves, open space areas, greenways, trails, and built structures for sport, recreation, or arts programs.

The types of parks and recreational facilities considered within the document are to cover the following, but not limited to;

- Buildings of physical activities (sports, games, fitness, swimming.)
- Buildings for social activities (parties, banquets, picnics)
- Outdoor activities (camping, walking/ hiking, backpacking)



This document provides the minimum technical requirements to be adopted by the Entity and/or contractors to enable safety, quality, and cost effectiveness in the operations of new and existing HVAC systems that meet the needs and expectations of the relevant Entity.

Using this document, the Entity shall establish and develop set procedures ensuring the continuous operations of HVAC systems for new and existing parks & recreational facilities. This may dictate the need to exceed the minimum requirements outlined within these guidelines.

3.0 DEFINITIONS

A universal list of terms and their associated definitions as they apply to the Entity are outlined in Volume 6, Chapter 3 of the National Manual of Assets and Facilities Management – EOM-ZM0-PR-000002– Descriptions and Definitions.

Definitions specific to this particular section of the National Manual of Assets and Facilities are listed below:

Term	Definition
ACH	Air Change per Hour
ACOP	Approved Code Of Practice
AE (V)	Authorized Engineer (Ventilation)
AHJ	Authority Having Jurisdiction
AHRI	Air Conditioning Heating and Refrigeration Institute
AHU	Air Handling Units
ANSI	American National Standards Institute
AP (V)	Authorized Person (Ventilation)
ASHRAE	American Society of Heating, Refrigeration, and Air Conditioning Engineers
ASME	American Society of Mechanical Engineers
Atmosphere	The gaseous envelope surrounding the earth (outside conditions)
BAS	Building Automation System
BIM	Building Information Modelling
BMS	Building Management System
CAV	Constant Air Volume
CMMS	Computerized Maintenance Management System
Concealed Exterior	Concealed from view and protected from weather conditions and physical contact by building occupants but subject to outdoor ambient temperatures
Concealed Interior	Concealed from view and protected from physical contact by building occupants
Conditioned	Spaces directly provided with heating and cooling
CP (V)	Competent Person (Ventilation)
CRAC	Computer Room Air-conditioning Unit
CRAH	Computer Room Air Handling Unit
DOAS	Dedicated Outside Air System
DPS/T	Differential Pressure Sensor/Transmitter
DSP	District Service Provider
DX	Direct Expansion cooling unit
EMCS	Energy Management and Control System
EMP	Emergency Management Plan
EPA	Environmental Protection Agency
ETS	Energy Transfer Station
Exposed Interior	Exposed to view indoors (not concealed)
Exposed, Exterior	Exposed to view outdoors or subject to outdoor ambient temperatures and weather conditions
FCU	Fan Coil Units



Finished Space	Space other than mechanical rooms, electrical rooms, furred spaces, pipe chases, unheated spaces immediately below roof, space above ceilings, unexcavated spaces, crawl spaces, tunnels, and interstitial spaces
FLS	Fire and Life Safety system
HEPA Filter	High Efficiency Particulate Air Filter
HSE	Health & Safety Executive
HSSE	Health, Safety, Security and Environment
HVAC	Heating, Ventilating, and Air Conditioning
IBC	International Building Code
IEC	International Electric Code
IMC	International Mechanical Code
Indoors	Located inside the exterior walls and roof of the building
KPI	Key Performance Indicators
KSA	Kingdom of Saudi Arabia
LEV	Local Exhaust Ventilation
NFPA	National Fire Protection Association
O&M	Operation & Maintenance
OSHA	Occupational Safety and Health Administration
Outdoors	Located outside the exterior walls and roof of the building
PTAC	Packaged Terminal Air Conditioning unit
RCA	Root Cause Analysis
RCL	Refrigerant Concentration Limit
RH	Relative Humidity
RTU	Roof Top Units
SBC	Saudi Building Code
ULPA Filter	Ultra-Low Particulate Air Filter
UMC	Uniform Mechanical Code
UPS	Uninterruptible Power Supply
VAV	Variable Air Volume
VFD	Variable Frequency Drive
VNI	Virtual Network Interface
VRF	Variable Refrigerant Flow
ZSCS	Zoned Smoke Control System

Table 1: Definitions

4.0 REFERENCES

- National Manual of Assets and Facilities Management – Volume 6, Chapter 3 – EOM-ZM0-PR-000002 Descriptions and Definitions Procedure
- National Manual of Assets and Facilities Management – Volume 5, Chapter 5 – EOM-ZO0-PR-000018 Building Management System (BMS) Operations – Offices
- National Manual of Assets and Facilities Management – EOM-ZO0-TP-000035 Emergency Response Action Checklist - HVAC Systems - Schools & Universities
- National Manual of Assets and Facilities Management – EOM-ZO0-TP-000032 Start-up Checklist – HVAC Systems – Schools & Universities
- National Manual of Assets and Facilities Management – EOM-ZO0-TP-000033 Shutdown Checklist – HVAC Systems – Schools & Universities
- National Manual of Assets and Facilities Management – EOM-ZO0-TP-000034 Systems Monitoring/Daily Rounds Checklist – HVAC Systems – Schools & Universities
- Saudi Building Code (SBC)
- SBC 201 Building Code – General
- SBC 401 Electrical Code
- SBC 501 Mechanical Code
- SBC 601 Energy Conservation



- Expro Projects White Book Mechanical Design Guidelines
- Expro Projects White Book, Volume 11, HSSE Introduction
- Chartered Institution of Building Services Engineers (CIBSE) Guide M
- HSE Approved Code of Practice (ACOPs) L8 & HSG274
- ASHRAE Handbook – Fundamentals
- ASHRAE Handbook – Refrigeration
- ASHRAE Handbook – HVAC Applications
- ASHRAE Handbook – HVAC Systems and Equipment
- ASHRAE Standard 15 – Safety Standard for Mechanical Refrigeration
- ASHRAE Standard 34 – Designation and Safety Classification of Refrigerants
- ASHRAE Standard 62 – Ventilation for Acceptable Indoor Air Quality
- ASHRAE Laboratory Design Guide (2nd Edition)
- National Fire Protection Association (NFPA) 70 – National Electrical Code
- NFPA 90A – Standard for Installation of Air Conditioning and Ventilation Systems
- NFPA 92 – Standard for Smoke Control Systems
- NFPA 96 – Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations
- NFPA 101 – Life Safety Code

Note: Based upon the requirements on international best practices and standards. These shall be from Saudi Building code (SBC) and the American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE), Health Technical Memorandum (HTM), National Fire Protection Association (NFPA), American National Standards Institute (ANSI).

These shall be selectively applied based on the evaluation of individual requirements. Where the standards stipulated conditions conflict, the most stringent shall govern, unless otherwise noted herein. When there is any conflict with the Saudi Building Code (SBC), only the Saudi Building Code will be applied.

5.0 RESPONSIBILITIES

The Entity is the final Authority Having Jurisdiction (AHJ) unless specifically stated otherwise in other sections of the National Manual of Assets and Facilities Management. If a conflict is discovered between these guidelines and other operations management documents, it shall be brought to the attention of the Entity which will provide a resolution or direction to evaluate if all HVAC goals and requirements have been met.

Descriptions of these responsibilities are outlined below and depicted in the organizational structure in Figure 1.

5.1 Organizational Structure

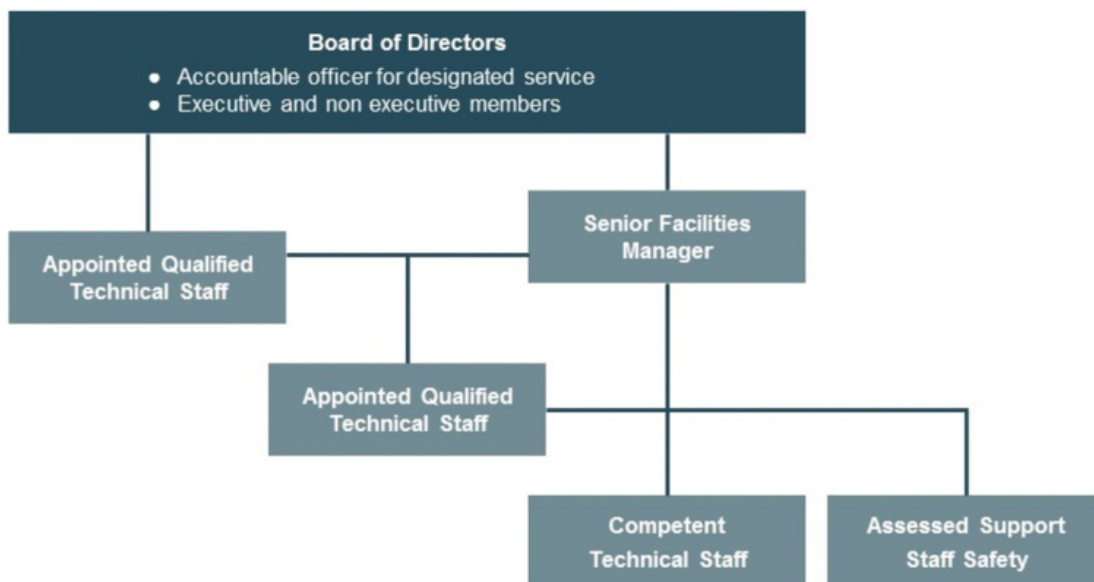


Figure 1: Organizational structure

5.2 Management Responsibilities

It is a responsibility of management to ensure that inspection, service and maintenance activities are carried out safely without hazard to staff, or members of the public. Clear lines of managerial responsibility should be in place so that no doubt exists as to who is responsible for the safe operation and maintenance of the equipment. A periodic review of management systems should take place in order to ensure that the agreed standards are being maintained.

Management is also responsible for maintaining records of the asset's condition and systems being maintained and for taking on operational ownership of the repaired, replaced, altered or extended assets or systems.

5.3 Designated Person

This person provides the essential senior management link between the organization and professional support. The Designated Person should also hold an informed position at board level.

5.4 Authorized Engineer (Ventilation) (AE (V))

The AE (V) is defined as a person designated by Management to provide independent auditing and advice on ventilation systems and to review and witness documentation on validation.

5.5 Authorized Person (Ventilation) (AP (V))

The AP(V) is an individual possessing adequate technical knowledge and having received appropriate training, appointed in writing by the Designated Person (in conjunction with the advice provided by the AE(V)), who is responsible for the practical implementation and operation of Management's safety policy and procedures relating to the engineering aspects of ventilation systems.

5.6 Competent Person (Ventilation) (CP (V))

The CP (V) is defined as a person designated by Management to carry out maintenance, validation, and periodic testing of ventilation systems.



5.7 Plant Operator

The Plant Operator is any person who operates a ventilation installation.

5.8 End User

The End User is the person responsible for the management of the unit in which the ventilation system is installed (e.g., Head of Department, manager, supervisor or another responsible person).

5.9 Contractor

The Contractor is the person or organization responsible for the supply of the ventilation equipment, its installation, commissioning, or validation. This person may be a representative of a specialist ventilation organization or a member of the General Manager/Chief Executive's staff.

6.0 PROCESS

6.1 Operations Management

6.1.1 Operational Policy

The Entity Organization's Board of Directors shall be responsible for setting overall operational policies and it is the responsibility of the Designated Person (DP), as the senior executive, to implement these policies.

The main recommendations for operational policy are that all ventilation plants should meet a minimum requirement in terms of the control of Legionella and safe access for inspection and maintenance. All ventilation plants should be inspected annually and the performance of all critical ventilation systems (such as those servicing data rooms) should be verified annually.

6.1.2 Monitoring of the Operational Policy

The Designated Person (DP) is responsible for monitoring the operational policy to ensure that it is being properly implemented. This should be carried out on a regular basis, and the procedure for such monitoring should be set out in the operational policy.

6.2 Risk Management

Critical pieces of equipment (assets) within a park or recreational facility have a greater impact on overall performance. Hence, it is crucial to identify any equipment that is critical in ensuring the safety, comfort and amenity of a facility, particularly in commercial rented spaces, elevator and central plant rooms. The Entity should plan for major plant failure by procuring critical assets such as portable air conditioning units and developing a Risk Management Plan to minimize downtime and inconvenience to end users.

The loss of service of these areas would seriously degrade the ability of the premises to deliver optimal services. In order to ensure reliable service provisions, it is essential to inspect, verify and maintain these HVAC systems at appropriate intervals. For many of these systems, a permit-to-work will need to be completed to ensure that taking the ventilation system out of service does not compromise the activities of the user department. In any event, it will be necessary to liaise with the user department when switching the system off to carry out routine inspection and maintenance.

6.3 Emergency Management

Emergency procedures are intended to highlight the key issues that may arise at departmental level in the event of HVAC systems failure. Good practice in emergency management should include development of an Emergency Management Plan (EMP) which outlines responsibilities, identification of high risk areas and appropriate responses, and clearly identifies safe areas during an emergency and an evacuation plan for disabled persons.



6.4 Operational Considerations

6.4.1 Health, Safety, Security, and Environment (HSSE)

HVAC systems Operations Management shall be completed in full accordance to the respective Health, Safety, Security and Environment requirement (Refer to National Manual of Assets and Facilities Management Volume 10, Chapter 2 – Health, Safety, Security, and Environment (HSSE)).

All safety aspects of operation associated with plant or equipment should be clearly understood by operational staff. End-users and other key staff should be aware of the purpose of any alarm systems and of the course of action to be taken in the event of an emergency occurring.

In order to prevent unwanted interference with plant and controls, all means of service isolation, regulation and control should be located and secured in such a way that they can be fixed in the “normal” position and be free from unauthorized adjustments. All plant rooms should be kept locked, signed and under access control. Signage should be displayed to alert individuals that they are entering a restricted area.

6.4.2 Environmental

It is important to achieve a balance between economy in capital and energy costs while creating appropriate levels of comfort through mechanical ventilation/comfort cooling. Natural ventilation is always the preferred solution for a space, provided that the quantity and quality of air required and consistency of control to suit the requirements of the space are achievable. If this is not the case, a mechanical ventilation system will be required.

6.4.3 Records/drawings

The Entity should have accurate and up-to-date records and/or drawings. Where possible, these should be backed up electronically. They should be readily available on site in an appropriate format for use by any AP/V responsible for engineering services and CP/V inspecting or maintaining them. Facilities Management should also be aware of the increasing use of Building Information Modeling (BIM) and have the provisions to access BIM information where possible.

6.4.4 Training

All personnel employed in the operation and management of HVAC engineering services should receive adequate documented training. Personnel should not commence their duties until this training has been completed, competency has been validated and detailed operating instructions have been provided.

It is essential that practical training be given to all operational staff to ensure that work routines, operational procedures (including permit-to-work systems), and correct application of the safety procedures and rules are implemented.

6.5 HVAC Fundamentals

A central heating system provides thermal comfort to the whole interior of a building (or portion of a building) from one point to multiple rooms. When combined with a cooling system, in order to control the building climate, the whole system may be considered as HVAC.

HVAC in parks & recreational facilities are also used for quality conditioned air supplied to areas like sports halls, changing areas and commercial catering. The air quality within a building is influenced by external and internal factors. The ability to maintain satisfactory air quality depends on identifying the factors that affect air quality in a particular application, controlling or eliminating detrimental factors, and promoting beneficial ones.

External factors include, but not limited to:

- Vehicle traffic, including parking & workshops facilities.
- Building geography: urban or rural.



Internal factors include, but not limited to:

- Internal building works and refurbishments.
- Local processes generating fumes or vapors.

Precautionary measures that can be implemented to prevent the repercussions caused by the contaminants above include, but are not limited to:

- Eliminating contaminants by preventing the use of volatile solvents and sprays.
- Diluting dust and odors through the introduction of fresh, filtered air.

Ventilation systems with terminal re-circulatory facilities may act as secondary contaminant sources, as internally generated dust and microbes will, unless removed by regular filter replacement and cleaning, accumulate and be ejected back into the conditioned space.

Specific guidelines related to elements of central heating and cooling equipment can be found in the ASHRAE standards cited in the References section of this document

HVAC takes into consideration the following operating parameters

HVAC – Heating, Ventilation, Air-conditioning		
●	Temperature	68°F (20°C) and 75°F (25°C)
●	Humidity	30% relative humidity (RH) and 60% RH
●	Pressure	A slightly positive pressure to reduce outside air infiltration
●	Ventilation	Rooms typically have several complete air changes per hour

Figure 2: HVAC Heating, Ventilation, and Air-conditioning Operating Parameters

6.6 Systems Overview

6.6.1 HVAC Plant & Equipment

Users of HVAC plant and equipment similarly need to be aware of the system fundamentals in order to participate in the safe operation of the systems and to understand the purpose of warning alarms. They should be familiar with their arrangement and be able to start, stop, and isolate these systems in the event of an emergency. Service providers should also be aware of current operational techniques to increase equipment efficiency, and reliability in relation to improving the HVAC utilization in existing and new buildings with the added benefits of:

- Increased equipment life to meet with design life cycle.
- Reduced downtime of plant and services through effective and targeted maintenance.
- Utilization of best in class maintenance services.
- Visibility of plant condition through effective reporting.
- Increased performance and reduced utility costs.

6.7 Building Management Systems (BMS)

All HVAC plant and equipment associated with the internal environment should, where possible, be monitored and controlled by a BMS. Effective systems should be in place for both off-site and on-site response to alarms.

The maintenance of HVAC systems requires integration with other discipline such as, but not limited to, the fire alarm system and related to smoke control dampers. For most applications, sensors, and actuators are



linked into outstations which gather data and act to provide the form of control, thereby remotely transmitting information to the operator for real time optimization of the HVAC plant.

6.8 Example of the Sub system found within HVAC

- Central Heating and Cooling
- Air Distribution System
- In-Room Terminal Systems
- Applied Heat Pump and Heat Recovery Systems
- Forced Air Heating and DX Cooling Systems
- Steam Systems
- Hydronic Heating and Cooling
- Condenser Water Systems
- Variable-Refrigerant Flow Systems
- Dust Collection Systems
- Hydronic Heating and Cooling
- Condenser Water Systems
- Specialist Systems
- Emergency Systems

6.9 Sample of Equipment found within System

- Direct Expansion (DX)
- Variable-Refrigerant Flow (VRF)
- Variable Air volume (VAV)
- Computer Room Air Conditioning (CRAC)
- Constant Air Volume (CAV)
- Roof Top Units (RTU)
- Air Handling Units (AHU)
- Fan Coil Units (FCU)
- Hybrid Heat Pump
- Chilled beams
- Local Exhaust Ventilation (LEV)

7.0 START-UP PROCEDURE

A start-up procedure is a reference document to be used while preparing a process to operate a system from an offline position. The actions within the procedure are intended to ensure that a methodological approach is taken to restore or commence a potentially dangerous system or a piece of equipment back online. Start-up procedures for HVAC shall include the following, but are not limited to:

- Health and Safety.
- Pre- Approvals.
- System Readiness.
- Pre- Start Checks.
- Start Checks.
- Notifications.

8.0 SHUTDOWN PROCEDURE

A shutdown procedure is a reference document for a planned activity to take a system or a piece of equipment offline. The shutdown procedure should be clear, prescriptive and well understood. The specific steps often mirror those taken with a startup procedure but include additional consideration for the effect on utilities and other active building services connected to the process. HVAC shutdown procedures shall include the following, but are not limited to:

- Health and Safety.
- Pre- Approvals.



- Standby System Condition.
- Pre-Shutdown Checks.
- Routine Stop.
- Post Stop Checks.
- Notifications.

9.0 SYSTEMS MONITORING/DAILY ROUNDS

9.1 Monitoring

Facilities Management/Service Providers should consider the following items that need to be monitored:

- Key Performance Indicators (KPI) – normally agreed between the facilities management company and the Entity
- The primary sources of supply supporting a HVAC system should be monitored for any outages and their reasons recorded. In some cases, the District Service Provider (DSP) will need to be contacted directly for an explanation in the event of a prolonged power outage.
- Work Orders under the Computer (or paper) Maintenance Management System (CMMS) should be actioned in accordance with the agreed contract requirements based on priorities and urgency levels such as routine, urgent and emergency work orders
- Assets listed in the Computerized Maintenance Management System (CMMS) should be audited and kept up to date as per the agreed contract requirements. This is to prevent the accumulation of unregistered assets not visible on the CMMS system and hence, be at risk from lack of maintenance
- Suitable trained staff shall be employed by the service provider for the purpose of monitoring plant and equipment. If the staff is not suitably qualified, competent, or available, the service provider should arrange for the appointment of an approved/authorized contractor to provide this service or support.
- Energy usage should be monitored and recorded in relation to site volume, floor area, occupant numbers, and specialism i.e.; computer rooms (due to high energy usage). Seasonal variations in energy usage should also be monitored to assist in highlighting anomalies in temperature, humidity, pressure and ventilation across the sites

10.0 EMERGENCY RESPONSE ACTIONS

The aim of this emergency procedure is to provide guidance and a structured approach to the management response in case of a major failure of a HVAC system, and to safeguard users/occupants from any such failure.

The following procedures are designed to instruct and advise on the operational requirements for dealing with such a compromised ventilation system. It is not considered a definitive guide on emergencies as the specific circumstances of the incident will ultimately determine the course of action taken.

10.1 Airborne Contamination

10.1.1 Causes

HVAC ventilation may become compromised by contamination in several ways including:

- Contamination of the incoming air supply to the recreational facility.
- Contamination caused by the corrosion or decay of materials in contact with the ventilation ductwork; e.g., rusting metal and vermin).
- Cross-contamination of ventilation supply because of a process not carried out correctly on site by staff or contractors where the safety protocols are inadequate or non-existent (e.g., contamination due an unauthorized plant shutdown and loss of pressure).

10.1.2 Effects



The possible effects of a compromised system are varied, and will depend on the severity and degree of the contamination, however a further investigation should be carried out if:

- Users complain about the air supply quality or if it is discolored
- The supply air has a distinctive odor. This could be the result of chemicals (e.g., chlorine) or decaying matter
- The air supply appears normal but people using it have become sick/infected.

10.1.3 Response Actions

- Staff should safely complete or suspend any work being undertaken and prioritize their attention on the most critical equipment. Local standby supplies and equipment-based systems should be checked. Wherever necessary, manual intervention should be made to ensure the safety of users.
- When supply is restored, the AP (V) should ensure that all essential equipment is functioning correctly and, where necessary, transfer equipment onto essential supplies. On restoration of the primary supply, the AP/V should check that all systems and equipment have been reset to normal.

10.1.4 Investigation

The size of the affected area must first be ascertained. This will give some indication of the extent of the problem and may help to identify the source of the contamination. Further actions may or may not be required, depending on whether part of or the whole ventilation system has been compromised. Inform the senior management of affected departments to cease using the system. Once the extent has been determined, an assessment should be undertaken as to the nature of the contamination. It is advised that the infection control officer is involved.

10.1.5 Damage Control

- The cause and result of the damage to the system should be investigated by the Authorized Engineer/Authorizer Person AP/AE (V) and drawings and schematics should be made readily available.
- Measures should be taken to limit the amount of disruption, and temporary backup systems should be protected by sealing off damaged areas during repairs. Following damage limitation, lock off tag out (LOTO) the damaged section where possible and ensure back-up support is functioning.

10.1.6 Debriefing

Following return to normal, a team debriefing should be held to review the emergency procedure and update or correct any apparent weaknesses.

10.1.7 Review Procedure

- This procedure will be reviewed following any change in personnel, equipment, materials and environment. It shall be reviewed at regular intervals not exceeding 12 months.
- Where deemed necessary a Root Cause Analysis (RCA) should be undertaken to understand the event or sequence of events leading to a failure and allow a review of current practices to be undertaken. Implementing improvement or change where this may be found as necessary.

10.1.8 Training and Information

- All staff involved will receive adequate training and instruction to enable them to carry out these procedures with confidence during an emergency. This training will be recorded in a formal training log and updated on a regular basis.

10.1.9 Examples of Templates Procedures and Checklists

The following procedures and checklists have been prepared for facilities management and service providers personnel to meet the needs of their own organizations during failure of a system. They are not



intended to be applicable or definitive for all facilities, but they give an indication of the types of format that may be used and the different levels of technical content that may be appropriate on different sites.

Further procedures may be required within a municipal Entity, and it is recommended that a regular review be undertaken to ensure that directives for staff and equipment remain current.

11.0 ATTACHMENTS

1. Attachment 1 – EOM-ZO0-TP-000048 – Start Up Checklist - HVAC Systems - Parks & Recreation
2. Attachment 2 – EOM-ZO0-TP-000049 – Start Up Checklist - HVAC Systems - Parks & Recreation
3. Attachment 3 – EOM-ZO0-TP-000050 – Systems Monitoring/Daily Rounds Checklist - HVAC Systems - Parks & Recreation
4. Attachment 4 – EOM-ZO0-TP-000051 – Emergency Response Action Checklist - HVAC Systems - Parks & Recreation

**Attachment 1 – EOM-ZO0-TP-000048 – Start-Up Checklist - HVAC Systems - Parks & Recreation**

Building Name:		Reference No.		REV- 001	
Vol 5 Operations Management Chapter 4					
No.	Start-Up Procedure	CHECKED SATISFACTORY			
		N/A	YES	NO	
	HVAC Systems – Parks & Recreation				
	Health and Safety				
1	Required PPE available	☐	☐	☐	
2	Risk Assessments Method Statement (RAMS) available	☐	☐	☐	
3	Chemical MSDS & PDS checks availability	☐	☐	☐	
4	Location of first-aid instructions and supplies available	☐	☐	☐	
5	Emergency eyewash and showers available	☐	☐	☐	
6	Emergency evacuation plan reviewed	☐	☐	☐	
7	Emergency contact details of the authorized person and the contractors	☐	☐	☐	
8	Life Safety Systems (fire extinguishers, sprinklers, gas suppression & fire alarm)	☐	☐	☐	
9	Ventilation	☐	☐	☐	
	Pre-approvals				
10	System owner/ Manager/ Engineering team approvals available	☐	☐	☐	
11	End-user department head approvals available	☐	☐	☐	
12	QHSE approvals available	☐	☐	☐	
13	Specialist contractor schedule of work	☐	☐	☐	
14	Approved permit to work (PTW)	☐	☐	☐	
	System Readiness				
15	System pressure checks	☐	☐	☐	
16	System temperature checks	☐	☐	☐	
17	Humidity levels checks	☐	☐	☐	
18	System is hazardous free and no leaks checks	☐	☐	☐	
19	Condense test kit checks	☐	☐	☐	
20	Filter stocks & expiry checks	☐	☐	☐	
21	Required tools checks	☐	☐	☐	
22	Lock Off Tags Out (LOTO) checks	☐	☐	☐	
23	Confirm with schematic and Building Management System (BMS)	☐	☐	☐	
24	Areas are cleaned and egress checks	☐	☐	☐	
	Pre-Start Checks				
26	System fault free / alarm free checks	☐	☐	☐	
27	Original Equipment Manufacturers (OEM) Start-up procedure available	☐	☐	☐	
28	Automatic controller checks	☐	☐	☐	
29	Parameters set point checks	☐	☐	☐	
30	Magnahelic gauge checks	☐	☐	☐	
31	Frost coil checks	☐	☐	☐	
32	Heater batteries visual inspection checks	☐	☐	☐	
33	Previous service reports checks (3 rd party specialist)	☐	☐	☐	



Attachment 2 – EOM-ZO0-TP-000049 – Start-Up Checklist - HVAC Systems - Parks & Recreation

Building Name:		Reference No.	REV-001	
Vol 5 Operations Management Chapter 4				
No.	Shutdown Procedure	CHECKED SATISFACTORY		
		N/A	YES	NO
	HVAC Systems – Parks & Recreation			
	Health and Safety			
1	Required PPE available	☐	☐	☐
2	Risk Assessments Method Statement (RAMS) available	☐	☐	☐
3	Chemical MSDS & PDS checks availability	☐	☐	☐
4	Location of first-aid instructions and supplies available	☐	☐	☐
5	Emergency eyewash and showers available	☐	☐	☐
6	Emergency evacuation plan reviewed	☐	☐	☐
7	Emergency contact details of the responsible person and the contractors	☐	☐	☐
8	Life Safety Systems (fire extinguishers, sprinklers, gas suppression & fire alarm)	☐	☐	☐
9	Ventilation	☐	☐	☐
	Preapprovals			
10	System Owner/ Manager /Engineering team approvals available	☐	☐	☐
11	End-user department head approvals available	☐	☐	☐
12	QHSE approvals available	☐	☐	☐
13	Specialist contractor schedule of work	☐	☐	☐
14	Approved permit to work	☐	☐	☐
	Standby System Condition			
15	System operating condition checks	☐	☐	☐
16	System leakage free checks	☐	☐	☐
17	System faults/alarm free checks	☐	☐	☐
18	Water flow checks	☐	☐	☐
19	Systems parameters checks	☐	☐	☐
	Pre Shutdown Checks			
20	System is alarm free checks	☐	☐	☐
21	Automatic control panel parameters checks	☐	☐	☐
22	Set points checks	☐	☐	☐
23	Pressure gauges	☐	☐	☐
24	Magnahelic / gauges	☐	☐	☐
25	Heat recovery checks	☐	☐	☐
26	All related valves open - closeout checks	☐	☐	☐
	Routine Stop			
27	LOTO remove checks	☐	☐	☐
28	Stop fan from BMS	☐	☐	☐
29	Stop water supply	☐	☐	☐
30	Stop electrical power supply	☐	☐	☐
31	Close valves checks	☐	☐	☐
	Post Stop Checks			
32	Open basin drain valves	☐	☐	☐
33	Air quality parameters checks	☐	☐	☐



HVAC Systems Operations – Parks and Recreation Procedure

Attachment 3 – EOM-ZO0-TP-000050 – Systems Monitoring/Daily Rounds Checklist - HVAC Systems - Parks & Recreation

Building Name: Vol 5 Operations Management Chapter 4		Reference No.		REV- 001	
No.	Systems Monitoring / Daily Rounds	CHECKED SATISFACTORY			
		N/A	YES	NO	
	HVAC Systems – Parks & Recreation				
	This monitoring checklist is intended to highlight the key issues that may arise day to day at local level. The procedure and any supporting information should be reviewed and amended as necessary to ensure the document remains up-to-date and definitive for the facility				
1	System inspection and checking: (is the plant running)	☐	☐	☐	
2	System assessment: Is the unit and its associated plant secure from unauthorized access	☐	☐	☐	
3	Remote monitoring of ventilation and air conditioning systems and equipment (BMS)	☐	☐	☐	
4	Identifying maintenance risks on equipment and rising work orders	☐	☐	☐	
5	Investigating fault /alarms for HVAC systems.	☐	☐	☐	
6	Cleaning, adjusting of system	☐	☐	☐	
7	Performing emergency repairs promptly and efficiently.	☐	☐	☐	
8	Providing technical direction to ensure system maintains online	☐	☐	☐	
9	Keeping daily logs and records of all maintenance functions.	☐	☐	☐	
10	Ensuring compliance with appliance standards and with Occupational Health and Safety	☐	☐	☐	
11	Complying with service standards, work instructions and user requirements.	☐	☐	☐	
No.	Reviewer's Comments	Resolution			
Originator's Name / Signature and Date:		Checker's Name / Signature and Date:			

**Attachment 4 – EOM-ZO0-TP-000051 – Emergency Response Action Checklist -
HVAC Systems - Parks & Recreation**

Building Name:		Reference No.	REV- 001		
Vol 5 Operations Management Chapter 4					
No.	Emergency Response Actions	CHECKED SATISFACTORY			
		N/A	YES	NO	
	HVAC Systems – Parks & Recreation				
	Incident Action Plan (IAP)				
	This Incident Action Plan (IAP) is a guide intended for areas of a facility with complex services, for example a major sports facility or specialist plant room. The actions to be taken by Designated and Authorized persons may be expressed in a checklist. The steps below are simple indication of some issues that may arise although a more detailed list may be appropriate for each specific area. The Designated staff functions of staff personal need to be made clear in order that the correct measures are taken to minimize the impact of any crisis.				
1	Define ownership of the problem	☐	☐	☐	
2	Will public/ staff safety/care be affected	☐	☐	☐	
3	Will evacuation be required	☐	☐	☐	
4	Risk of fire outbreak, or reduced re-lighting ability	☐	☐	☐	
5	Consider impact on electricity supply	☐	☐	☐	
6	Consider impact on gas supply	☐	☐	☐	
7	Consider impact on water supply	☐	☐	☐	
8	Consider impact on drainage	☐	☐	☐	
9	Consider impact on other services	☐	☐	☐	
10	Increased risk of legionella	☐	☐	☐	
11	Consider impact on site security	☐	☐	☐	
12	Impact on alarms	☐	☐	☐	
14	Is there an impact on waste	☐	☐	☐	
15	Agree responsibility boundaries	☐	☐	☐	
16	Facility department procedures	☐	☐	☐	
17	Control of infection team involvement	☐	☐	☐	
18	Do public relations need to be addressed	☐	☐	☐	
19	Consider Service Level Agreements with suppliers	☐	☐	☐	
20	Involve commercial services	☐	☐	☐	
21	Record entities personnel contact details	☐	☐	☐	
22	Locate supply of specialist equipment	☐	☐	☐	
No.	Reviewer's Comments	Resolution			
Originator's Name / Signature and Date:		Checker's Name / Signature and Date:			